

FIRE-RATED ENCLOSURE FF130 SERIES:

FF130-2'x2', FF130-2'x4', FF130-600x600mm, FF130-600x1200mm

Step 1

Install the UL listed light fixture per the installation method and spacing requirements as specified in the individual UL design.

To accommodate for the electric supply a small hole can be easily poked through the cover without any tools.

Note: The electric supply should have a snug fit.



Step 2

Place a single spacer, approx. 4"x4" (e.g. piece of ceiling tile, mineral wool batt) centrally located on top of the light fixture to provide a minimum 0.5" clearance between the light and the cover.

For 2'x4' fixtures, use two spacers, one spacer on each end.

The height of the fixture housing shall not cause the bottom of the cover to lose contact with the ceiling tiles.



Step 3

Place the cover on top of the tee bar grid.


The hanger wires at the corners of the grid supporting the light fixture shall not be relocated.

Instead, slits (max. depth 100 mm as measured from the bottom of the cover) may be cut in the cover above the existing slots to accommodate the hanger wires and allow the cover to sit flush with the ceiling tiles.

A 0.5" clearance shall be maintained between the top, sides and ends of the fixture and the enclosure.

No additional sealant or fastening is required.

End-to-end or side-by-side installation of fixtures has not been investigated.

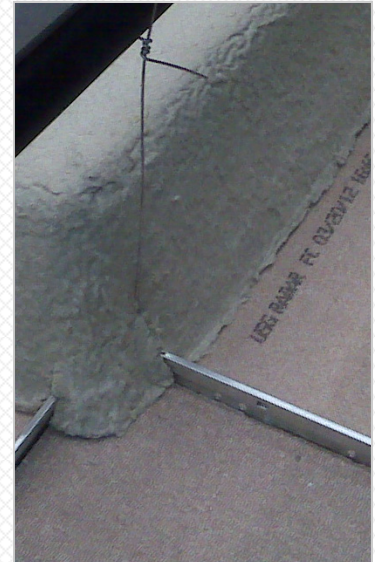

Type FF130 Series Fire Rated Troffer Cover luminaire enclosure for use as an alternate Fixture Protection for UL Listed fluorescent recessed troffer light fixtures with steel housings in the following Designs for 1 hr max ratings: A202, D203, D216, D219, G205, G208, G218, G252, G255, G256, G262, G264, J201, J202, L006, L201, L202, L206, L209, L210, P202, P204, P206, P207, P210, P211, P213, P214, P216, P225, P227, P228, P229, P230, P231, P235, P238, P242, P246, P250, P251, P254, P255, P259, P260, P261, P264, P265, P267, P268, P269.

WARNING: BE SURE THE ELECTRICITY TO THE SYSTEM YOU ARE WORKING ON IS TURNED OFF; EITHER THE FUSE REMOVED OR THE CIRCUIT BREAKER SET AT OFF.

CONTAINS STONE WOOL INSULATION

Stone fibers may cause temporary mechanical irritation to the skin, throat, nose and eyes.

FIRST AID

Skin

If irritation occurs, do not rub or scratch. Rinse under running water prior to washing with mild soap and water. Consult a physician if irritation persists.

Throat and Eyes

If irritation occurs, flush eyes with water and/or drink water to clear throat. Do not rub the eyes. Consult a physician if irritation persists.

PRECAUTIONS

- Wear long sleeve, loose fitting clothing, gloves and eye protection.
- For additional information, refer to the Material Safety Data Sheet (MSDS).

CLASSIFIED FOR FIRE RESISTANCE
FIRE RESISTANCE CLASSIFICATION
SEE UL FIRE RESISTANCE DIRECTORY

